



# econo-treat

## Econotreat VBB-C-2200 Treatment System

### System Specifications & Installation Instructions



# ECONOTREAT VBB-C-2200

## System Specification & Installation Instructions

*New Zealand's Leaders in Advanced Secondary Treatment Systems*

### Compliance Requirements

All NaturalFlow Treatment Systems meet the requirements of the NZ Building Code G13-VM4.

Section 9 of AS/NZS 1546.1:2008 state that tanks constructed to these Standards will meet the requirements of the Code for Clauses B1 and B2, structure and durability.

Compliance with Section 9 of AS/NZS 1546.1:2008 and also Clauses G13.3.4 relating to on-site treatment and disposal systems and G14.3.1 and 14.3.2 relating to the control of foul water as an industrial waste are covered in the 'NaturalFlow Compliance Requirements' document.

Please feel free to ask for a copy of this complete document, if required.

### The Treatment Process

#### Primary Chamber / Tank

Influent enters the chamber via the source whereby scum and solids capable of settling are separated from the raw influent. Primary treated effluent flows through a transfer port to the aeration tank. This primary tank will also act as a storage chamber for sludge returned from the Clarification Chamber.

#### Aeration Chamber

Water enters from the Primary Chamber. Air is introduced into this chamber via an air blower to create an environment for aerobic bacteria and other helpful organisms to consume the organic matter present. The aeration tank is designed in a manner to help prevent short circuiting of the wastewater to ensure extended aeration. Media is present in the tank to support the growth of bacteria.

#### Clarification Chamber

The Clarification chamber is essentially a quiescent zone where suspended particles/solids are settled out of the water. These particles are returned to the Primary chambers via a sludge return which aids in further biological reduction, denitrification and providing a constant food supply rich in microbes supporting the system through periods of limited flows.

# ECONOTREAT VBB-C-2200

## System Specification & Installation Instructions

*New Zealand's Leaders in Advanced Secondary Treatment Systems*

### Tank Specifications

Tanks are made of 50mpa Fiber Reinforced Concrete, which is suitable material for wastewater treatment containment meeting all the requirements of Section 4.3.3 of AS/NZS 1547:2012. These tanks have an expected lifespan of 50 years.

#### **Dual Chamber Septic Tank**

5200L Nominal Capacity  
2500mm Long  
1700mm Wide  
1975mm High

#### **Aeration Tank**

5200L Nominal Capacity  
2500mm Long  
1700mm Wide  
1975mm High

### Installation Location and Certification

These tanks are not designed for vehicle loads and shall be located no closer than 2m to a driveway, road frontage or a building. If for any reason the tank is located where vehicle traffic may drive over the tank or approach closer than 2m, or where it may be trampled on by farm stock then the tank should be protected by a concrete slab designed to support these loads. Surface water must also be diverted from flowing into the installation.

Installation must be certified to AS/NZS 1547:2012, the certificate to be issued and held by the regulatory authority.

### High Water Table Installations

All tanks have been engineered and designed for maximum strength, in accordance with the NZC 3604. Clauses B1 and B2 for structure and durability, to withstand any hydraulic pressures, both lateral and uplift, created by high water table conditions.

In high water table installations, it is important to fill the tanks with water. This removes the hydraulic uplift and simplifies the installation. In extremely high-water tables, a concrete foot can be added to the tank during manufacture. Waterflow must be made aware of this early on in view of supplying a tank that is fit for purpose.

### Plumbing Pipes and Fittings

All internal plumbing is done with PVC pipes with appropriate connections according to AS/NZS 1260 and AS/NZS 4130.

### Backfill and Bedding

Place and bed to NZBC G13/AS2, using compacted granular metal, in layers not exceeding 100mm.

***If in doubt contact the experts on 0800 SEWAGE or sales@waterflow.co.nz***

# ECONOTREAT VBB-C-2200

## System Specification & Installation Instructions

*New Zealand's Leaders in Advanced Secondary Treatment Systems*

### Electrical

Where a pump is required on a flat site electrical connection must be installed according to AS/NZS 3000 and the control and alarm system must be in a weatherproof housing located in a readily visible position.

### Warranty

WATERFLOW NZ LTD warrants that the Econotreat System will be free from defects in material and workmanship for the following periods of time from the date of installation as set out in the following conditions:

1. Concrete Tank 15yrs
2. Roto-Molded Tanks 15yrs
3. Nitto Blower 3yrs
4. Irrigation Pumps 2yrs
5. Warranty of Operation covers the performance of the NaturalFlow System as connected to the effluent inflow for which they are designed, and has been installed to the criteria as set out in the relative installation instructions and procedures, and has an assigned Service/Maintenance contract in place with Waterflow NZ Ltd or it's appointed agent/s.

#### Warranty excludes defects due to:

- A) Failure to use the system in accordance with owner's manual.
- B) A force majeure event outside the reasonable control of WATERFLOW NZ LTD such as (but not limited to) earthquake, fire, flood, soil subsidence, ground water table variations or plumbing fault.
- C) Modifications to surrounding landscape contour after installation
- D) The actions of a third party
- E) The system required to bear loads (either hydraulic or biological) greater than that for which it was designed
- F) Any modifications or repairs undertaken without the consent of WATERFLOW NZ LTD
- G) Failure, where applicable, to fence and plant disposal field.



1st June 2014  
Dean Hoyle  
Managing Director

# ECONOTREAT VBB-C-2200

## System Specification & Installation Instructions

### *Econotreat VBB-C-2200 Installation Instructions*

The Econotreat system is to be installed or signed off by a registered Drain layer to the design specified by Waterflow NZ Ltd.

The following installation instructions and procedures followed correctly will ensure System performance is not compromised in any way.

1. Excavate two 3m x 2m level platforms at an appropriate depth to ensure adequate fall for inlet pipe from the source. This has to be installed on virgin ground. The two platforms are ideally on the same level and next to each other, either side-by-side or end-on-end.
2. Lay 100mm of bedding metal on platform and place the Septic and Aeration tanks next to each other. As close as practically possible to minimize the connection distance between the tanks.
3. Connect the two tanks with 100mm PVC. If the tanks are side-by-side the connection will need supporting. This is done by tying it back to the wire on the lids with a length of rope supplied. The rope can be found in the top of the treatment tank.



Sludge return 25mm



Supported with rope

4. Next connect the sludge return. This is a 25mm PVC pipe that come out of the central riser on the treatment tank. This must be plumbed back to the second 100mm PVC at the start of the septic tank. It is important that this pipe is falling slightly or at minimum flat.
5. Trench from Dose Chamber outlet to disposal field and lay the 25mm alkathene feed line.
6. Take a minimum of 3 photos at this point to showing connections and back fill, to ensure correct installation for sign off.
7. Back fill around tanks. Using spoil from the excavation is fine, be aware that this will settle over time though.

**Caution:** System must be protected from excessive super imposed loads both lateral and top loads. E.g. loads from vehicular traffic. There needs to be at least 2m of clearance maintained around system.

***If in doubt contact the experts on 0800 SEWAGE or sales@waterflow.co.nz***


# ECONOTREAT VBB-C-2200

System Specification & Installation Instructions

*Econotreat VBB-C-2200 Schematic Drawings*



## Econotreat VBB-C-2200

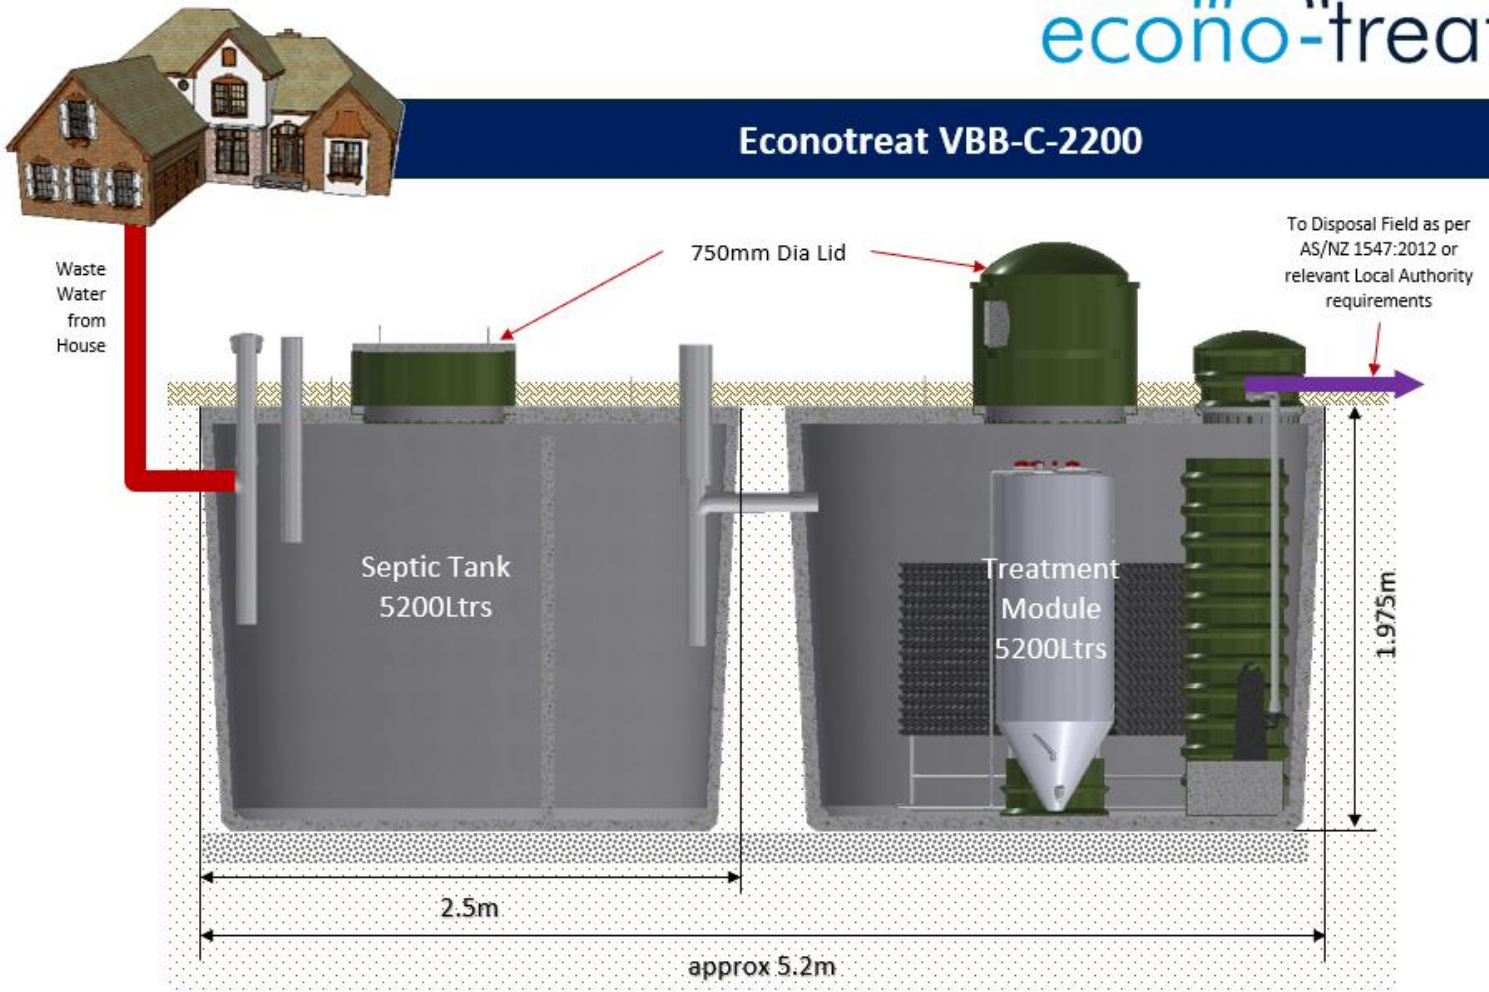

Copyright Waterflow New Zealand Limited 2021©

See our website: [www.waterflow.co.nz](http://www.waterflow.co.nz)




# ECONOTREAT VBB-C-2200

## System Specification & Installation Instructions

### Econotreat VBB-C-2200 Schematic Drawings

#### Side by Side Installation

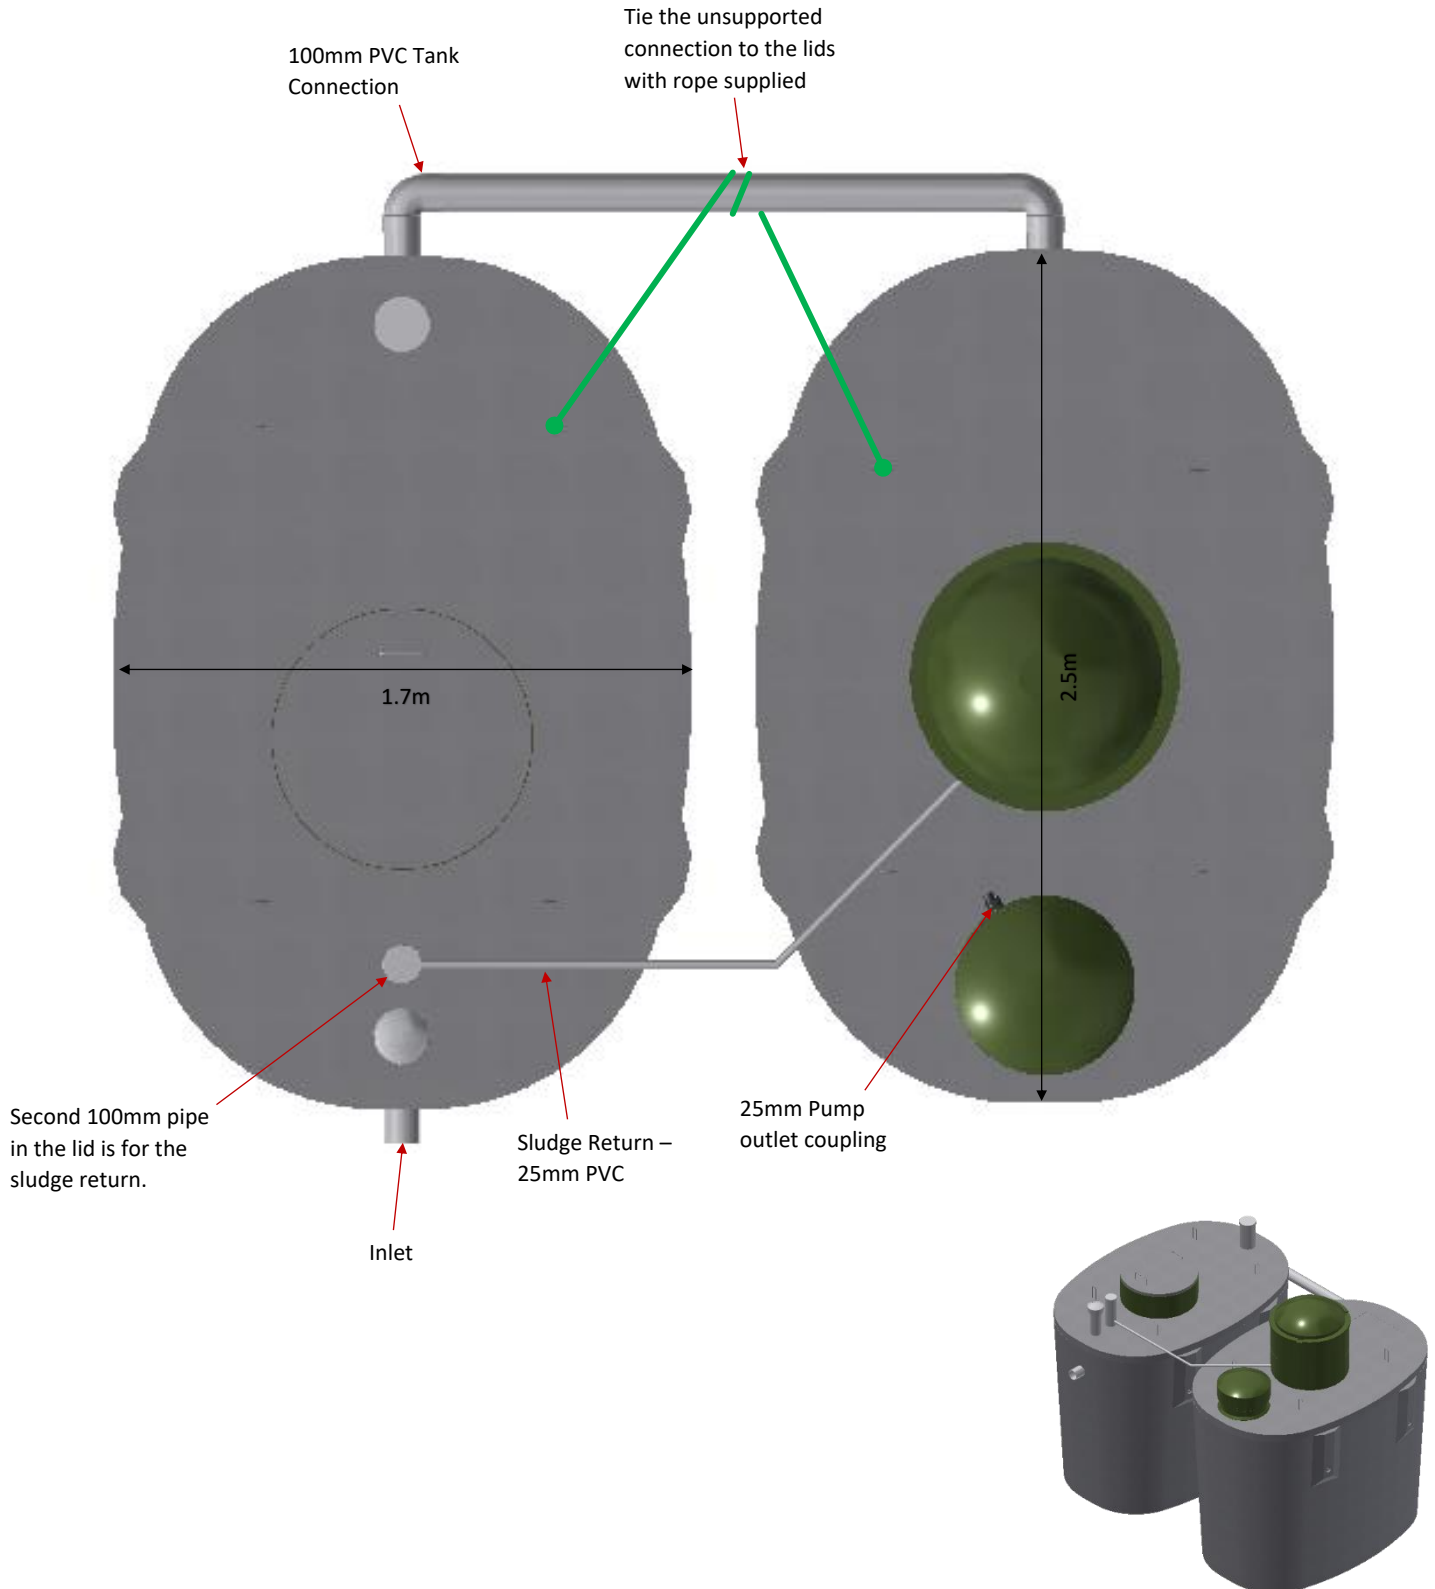


If in doubt contact the experts on 0800 SEWAGE or [sales@waterflow.co.nz](mailto:sales@waterflow.co.nz)

# ECONOTREAT VBB-C-2200

## System Specification & Installation Instructions

### Econotreat VBB-C-2200 Schematic Drawings

#### End on End Installation

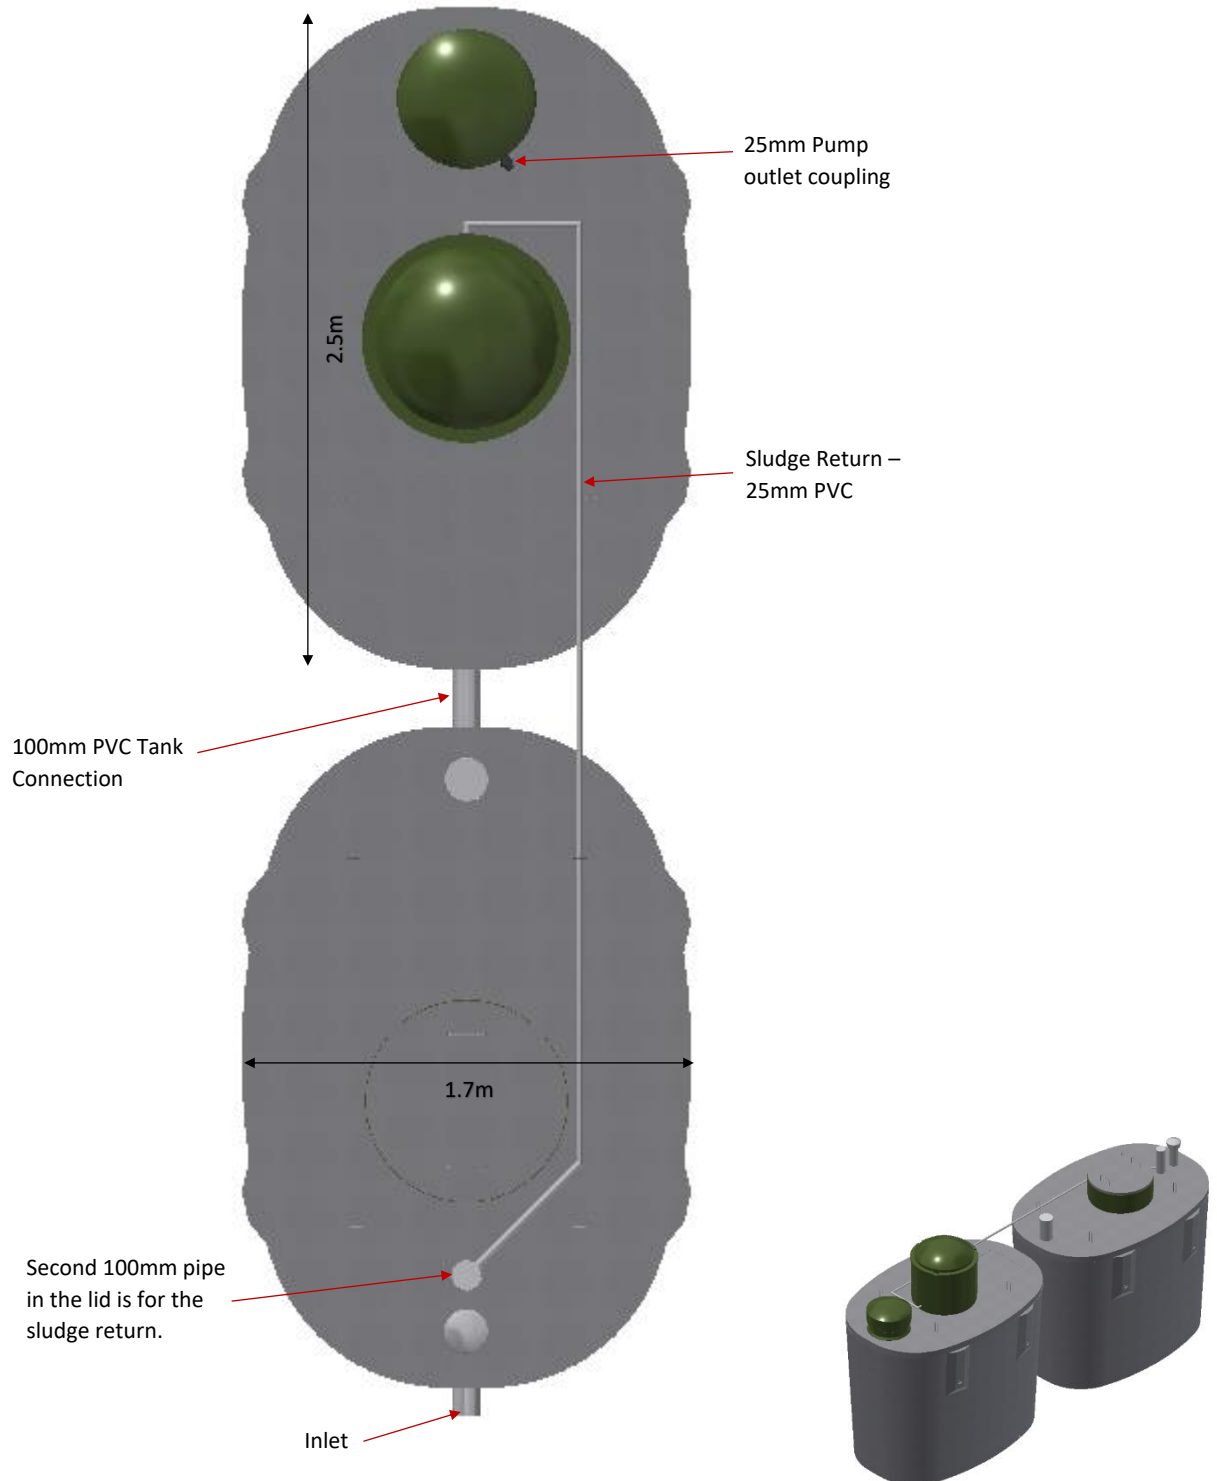





**“Making it Easy”**

**Call us today to discuss your needs**

**0800 SEWAGE**

**Or for more information [www.waterflow.co.nz](http://www.waterflow.co.nz)**



Head Office Waterflow NZ Ltd 1160 State Highway 12, Maungaturoto P. 09 431 0042	Waipapa Branch Waterflow NZ Ltd 166 Waipapa Road, Kerikeri P. 09 407 8323
---	---

FF. 0800 SEWAGE  
E. [sales@waterflow.co.nz](mailto:sales@waterflow.co.nz)  
[www.waterflow.co.nz](http://www.waterflow.co.nz)